


Standard Signage for Treatment & Chemical Dosing Plants

DANGEROUS GOODS MIXED CORROSIVES BULK STORE (Example only)

(Storage containers greater than 500 litres in capacity)

MIXED CORROSIVES (Example) BULK PLACARD (DS WCSS024_3)

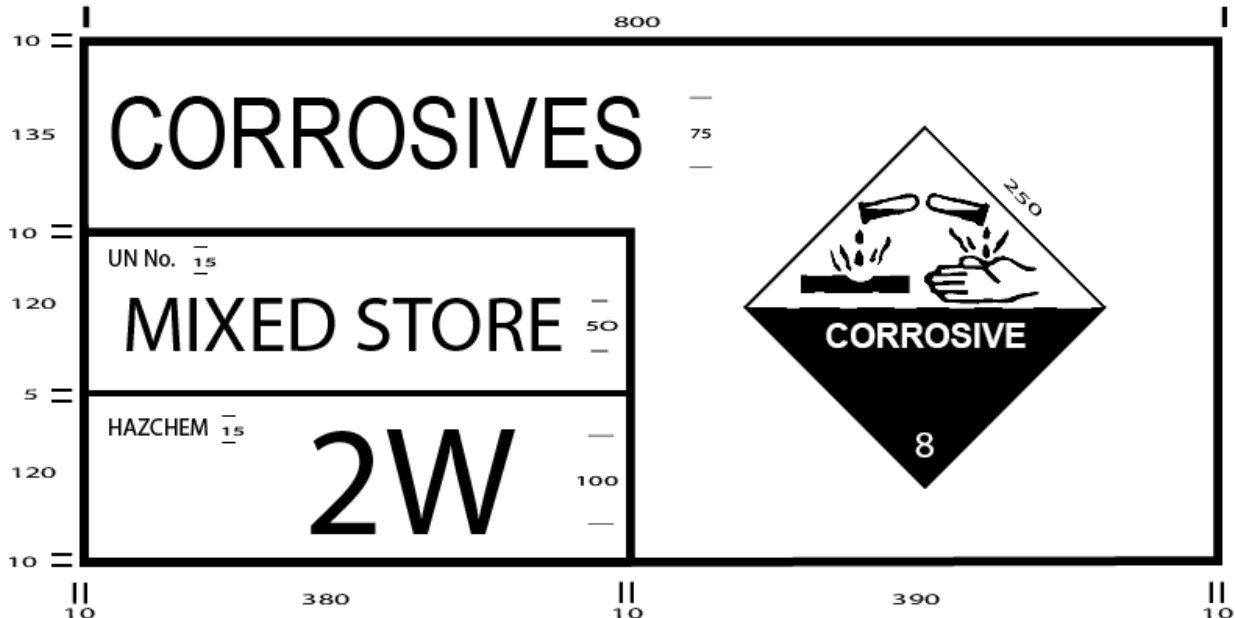

This example of a **Dangerous Goods Bulk Placard** has black text on a white background with the specified Dangerous Goods class label only.

Material: Metal or Vinyl – 800 (W) x 410 (H) with the other dimensions as indicated.

- A **Mixed Corrosives (Example) Bulk** placard is required for facilities that have multiple corrosive dangerous goods stored in tanks that are located in separate compounds within the same building.
- A **Mixed Corrosives (Example) Bulk** placard shall be posted on the outside wall near each entry door to the mixed corrosives store but is not to be obscured when the door is open. The placard shall be displayed at eye level so that it is visible from the normal direction of approach.

Note: The Hazchem Code may differ for each individual corrosive placard depending on the types of corrosive chemicals stored. Reference to the ADG Code - Emergency Action Codes (Appendix C3) needs to be considered.

Segregation of dangerous goods shall be undertaken in accordance with relevant Australian Standards.