


Standard Signage for Treatment & Chemical Dosing Plants

TREATMENT or CHEMICAL DOSING PLANTS

CHLORINE OR AMMONIA GAS SMALL PIPE MARKER (DS WCSS451)

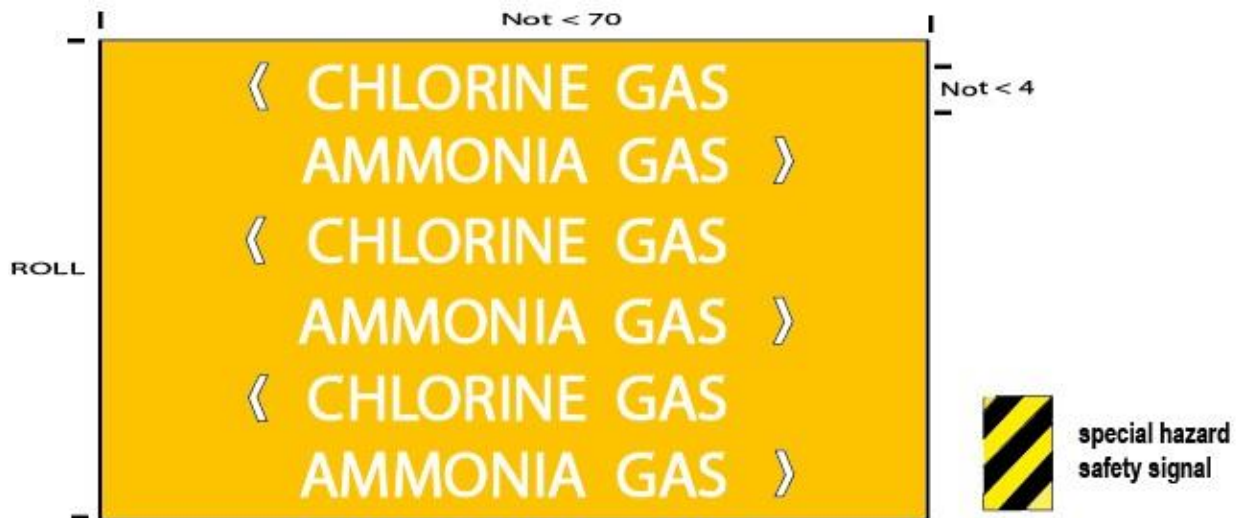

This **Identification Marker** is for pipe or tubing **less than 40mm** in diameter as per AS 1345 - 1995.

The text is white on a golden yellow background with chevrons to indicate directional flow of contents.

Material: Self-sticking vinyl (supplied on a roll then cut to suit pipe circumference).

- The **Chlorine or Ammonia Gas Small Pipe** marker shall be placed with the words longitudinally along the pipe so that they are visible from all directions.
- The **Chlorine or Ammonia Gas Small Pipe** marker is to be posted adjacent to all junctions, valves, service appliances, bulkheads, wall penetrations (and the like) and spaced not more than 8 metres apart.
- Note: Wherever there is **special hazard** (i.e. a *Dangerous Goods* that may cause harm to operators/maintainers within a service), then an additional yellow & black striped band shall be displayed in conjunction with the **Pipe Identification Marker**.