


Approval certificate

Trade waste pre-treatment product

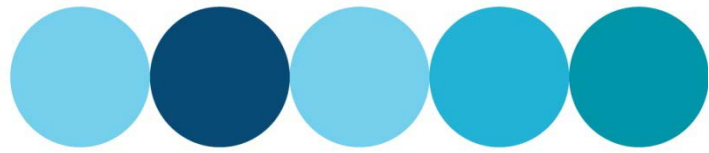

Applicant: Allied Pumps Pty Ltd
Postal address: PO Box 1468, Canning Vale, WA, 6970

Attention: Stephen Slack
Web: www.alliedpumps.com.au
Email: admin@alliedpumps.com.au

Manufacturer: SPEL Environmental
Address: PO Box 7138, Silverwater, NSW, 1811, Australia

Product/device description

The SPEL Purceptor is a full retention separator that can contain and prevent light liquid pollutants from discharging into sewers. It has two chambers, a coalescing unit and is fitted with an automatic closure device designed to treat and contain significant oil spills.

Treatable flow rates range from 2 L/s to 200 L/s. Pipe sizes range from 100mm to 450mm. Above and below ground installations are possible.

The approval certificate applies to the pre-treatment devices of the following sizes:


Approval Number	Model	Max Flow (L/s)	Max Silt (L)	Max Oil (L)	Total Litres	Working Litres	Inlet / Outlet Diameter (mm)*	Inlet Height (mm)	Outlet Height (mm)
AN-061-01	P.004.C1.2C	4	450	1,000	2,900	2,050	150 / 150	1,110	1,080
AN-061-02	P.006.C1.2C	6	600	1,300	3,400	2,550	150 / 150	1,070	1,040
AN-061-03	P.008.C1.2C	8	850	1,900	4,300	3,200	150 / 150	1,080	1,040
AN-061-04	P.010.C1.2C	10	1,100	2,500	5,200	3,900	150 / 150	1,110	1,080
AN-061-05	P.013.C1.2C	13	1,400	3,000	6,500	4,800	150 / 150	1,110	1,080
AN-061-06	P.015.L.C1.2C	15	1,750	3,400	7,400	5,400	150 / 150	1,100	1,040
AN-061-07	P.015.S.C1.2C	15	1,750	3,500	7,500	5,500	300 / 300	1,600	1,550
AN-061-08	P.020.C1.2C	20	1,980	3,900	9,800	7,300	300 / 300	1,600	1,550
AN-061-09	P.030.C1.2C	30	2,800	5,500	13,500	10,800	300 / 300	1,635	1,585
AN-061-10	P.040.C1.2C	40	3,500	7,000	17,200	14,400	300 / 300	1,600	1,550
AN-061-11	P.050.L.C1.2C	50	4,500	9,000	22,500	18,000	375 / 375	1,600	1,550
AN-061-12	P.060.L.C1.2C	60	5,400	10,700	26,800	21,600	375 / 375	1,550	1,450
AN-061-13	P.070.L.C1.2C	70	6,200	12,400	31,300	25,200	375 / 375	1,600	1,500
AN-061-14	P.050.S.C1.2C	50	3,300	9,000	20,100	18,000	375 / 375	2,230	2,180
AN-061-15	P.060.S.C1.2C	60	4,000	10,700	24,600	21,600	375 / 375	2,230	2,180
AN-061-16	P.070.S.C1.2C	70	4,700	12,400	29,300	25,200	375 / 375	2,200	2,150
AN-061-17	P.080.C1.2C	80	5,660	14,900	34,400	29,600	375 / 375	2,220	2,150
AN-061-18	P.090.C1.2C	90	6,000	16,200	38,300	32,400	375 / 375	2,235	2,150
AN-061-19	P.100.C1.2C	100	6,500	17,700	41,500	35,700	375 / 375	2,240	2,150
AN-061-20	P.110.C1.2C	110	7,000	18,300	44,300	38,200	375 / 375	2,250	2,150
AN-061-21	P.120.C1.2C	120	7,600	21,700	47,300	43,200	375 / 375	2,329	2,150
AN-061-22	P.150.C1.2C	150	9,600	27,100	63,000	54,000	375 / 375	2,280	2,150
AN-061-23	P.180.C1.2C	180	11,000	32,500	72,700	64,800	375 / 375	2,300	2,150
AN-061-24	P.200.C1.2C	200	12,000	36,200	78,100	64,800	375 / 375	2,300	2,150

* Maximum diameter possible. Smaller diameters available upon request.

Special conditions of approval

1. The product shall be *supplied* with manufacturer's installation instructions and recommended procedures for operation and maintenance.
2. The product shall be *installed* strictly in accordance with the manufacturer's written instructions and the *Plumbing Standards*, with particular emphasis on the following:
 - a. Where installed above ground oil water separators must be installed in a bunded area and connected back to the pump pit.
 - b. A Trade Waste Sampling Point (TWSP) must be installed according to the Corporation's typical drawings.
 - c. The outlet pipe must be plumbed via a tundish that is separate and upstream to the TWSP.
3. This approval certificate is not a stand-alone document and **must be read** in conjunction with Water Corporation's bunding requirements as shown in [Typical Drawings for Trade Waste – Coalescing Plate Separator \(HX33-12-10\)](#).
4. A maintenance contract is to be in place to ensure the ongoing reliability of the product.
5. Water Corporation must be notified within fourteen (14) days upon installation of the product
6. The use of emulsifying agents upstream of the product must not occur. Such instructions must be noted on operating documentation.

Approval certificate

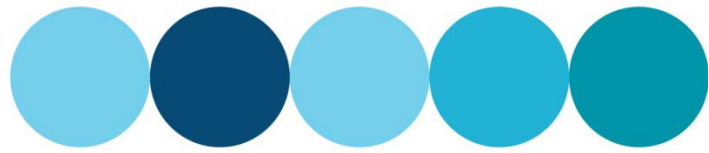

Trade waste pre-treatment product

Special conditions of approval (continued)

7. The product chosen must be suitably sized to avoid surge conditions.
8. Clear access for the purposes of maintenance or servicing of the pre-treatment device must be maintained at all times.
9. This approval certificate is not an endorsement of the product by Water Corporation, and no claim shall be made in advertising, promotion or other manner to the effect.
10. Water Corporation accepts no responsibility for the effective operation, performance or efficiency of the product. This approval is not an engineering approval or structural endorsement.
11. The proponent of the approved product must formally seek a request for re-approval of the product no later than three (3) months before the assigned **Validity Period** has expired from the **Date Issued** of this approval certificate.
12. Water Corporation reserves the right to vary any requirements at any time. Any application of this condition normally occurs after consultation with the manufacturer, supplier and end business user connected to Water Corporation's sewer.
13. Water Corporation shall be notified in writing if the pre-treatment device is withdrawn from sale.
14. The proponent of the approved product accepts that the information provided in this document shall be made publically available.

General conditions of approval

Approval shall be **suspended** where any of the following conditions are not met:

1. If there is a breach of the Special Conditions.
2. The assigned **Validity Period** has expired from the **Date Issued** of this approval certificate.
3. The product shall be manufactured in accordance with Water Corporation's requirements at the time of approval.
4. The product shall be manufactured to comply according to the details noted in the referenced documents below, in addition to any further details provided by the proponent when seeking this approval.
5. The product supplied for use in Water Corporation's area of operations shall comply with the requirements shown on this approval certificate. Sizes, classes, lengths or other product variables which are available with the product but which are not approved as listed on this approval certificate shall not be offered by the supplier for use in Water Corporation's area of operations.
6. All discharges to sewer associated with this product must not exceed Water Corporation's *Trade Waste Acceptance Criteria*.
7. Prior to any business (which is connected to Water Corporation's sewer) installing this product the business must apply to Water Corporation for a *Trade Waste Permit* for approval to discharge.
8. If this certificate has been issued to the manufacturer of this product then it is the responsibility of the manufacturer to ensure all current and future suppliers / vendors of this product are provided a copy of this approval certificate.

Approval shall be **reviewed** where any of the following conditions occur:

1. The product is manufactured with either different materials, methods of manufacture, location of manufacture, source of raw materials, component subcontractors or models to that at the time of approval.
2. The ownership of the primary manufacturer or any subcontractors is varied from that at time of approval.
3. The standards and/or specifications to which the product was required to comply with at the time of approval have been amended or revised.
4. The product has been found to sustain damage or provide unsatisfactory performance on occasions of number considered excessive by Water Corporation, when handled, stored, assembled or installed in accordance with the supplier's or manufacturer's written instructions.

Approved drawing(s):	SPEL Fibreglass Tank Installation Guide (dated July 2014, Rev 5) SPEL Purceptor Class 1 Operation & Maintenance Manual (dated April 2013, Rev 1)
Authorising person:	Stephen Jerkovic (Team Leader – Investigations)
Date issued	27 October 2017
Validity period:	Five (5) years