



HALGAN™ MGTA6000-WA ABOVE GROUND DETAIL

1. General

- 1.1. Tank constructed from Polyethylene.
- 1.2. Is to be installed in a location that will not cause a nuisance, obstruct fire access, cannot be vandalised or be damaged by vehicles.
- 1.3. Must have ease of access to pumpout point for maintenance.
- 1.4. Non standard installations require Halgan approval.

2. Installation above ground

- 2.1. The Halgan Tanks to be supported on a 100mm thick concrete pad.
- 2.2. Any maintenance platform must be installed in accordance with Australian Standard 1657-1992 allowing safe access while inspecting and maintaining.
- 2.3. All pipes connecting shall be fully supported; there shall be no stress on the tank connections.
- 2.4. All stormwater must be diverted away to prevent undermining of foundation.

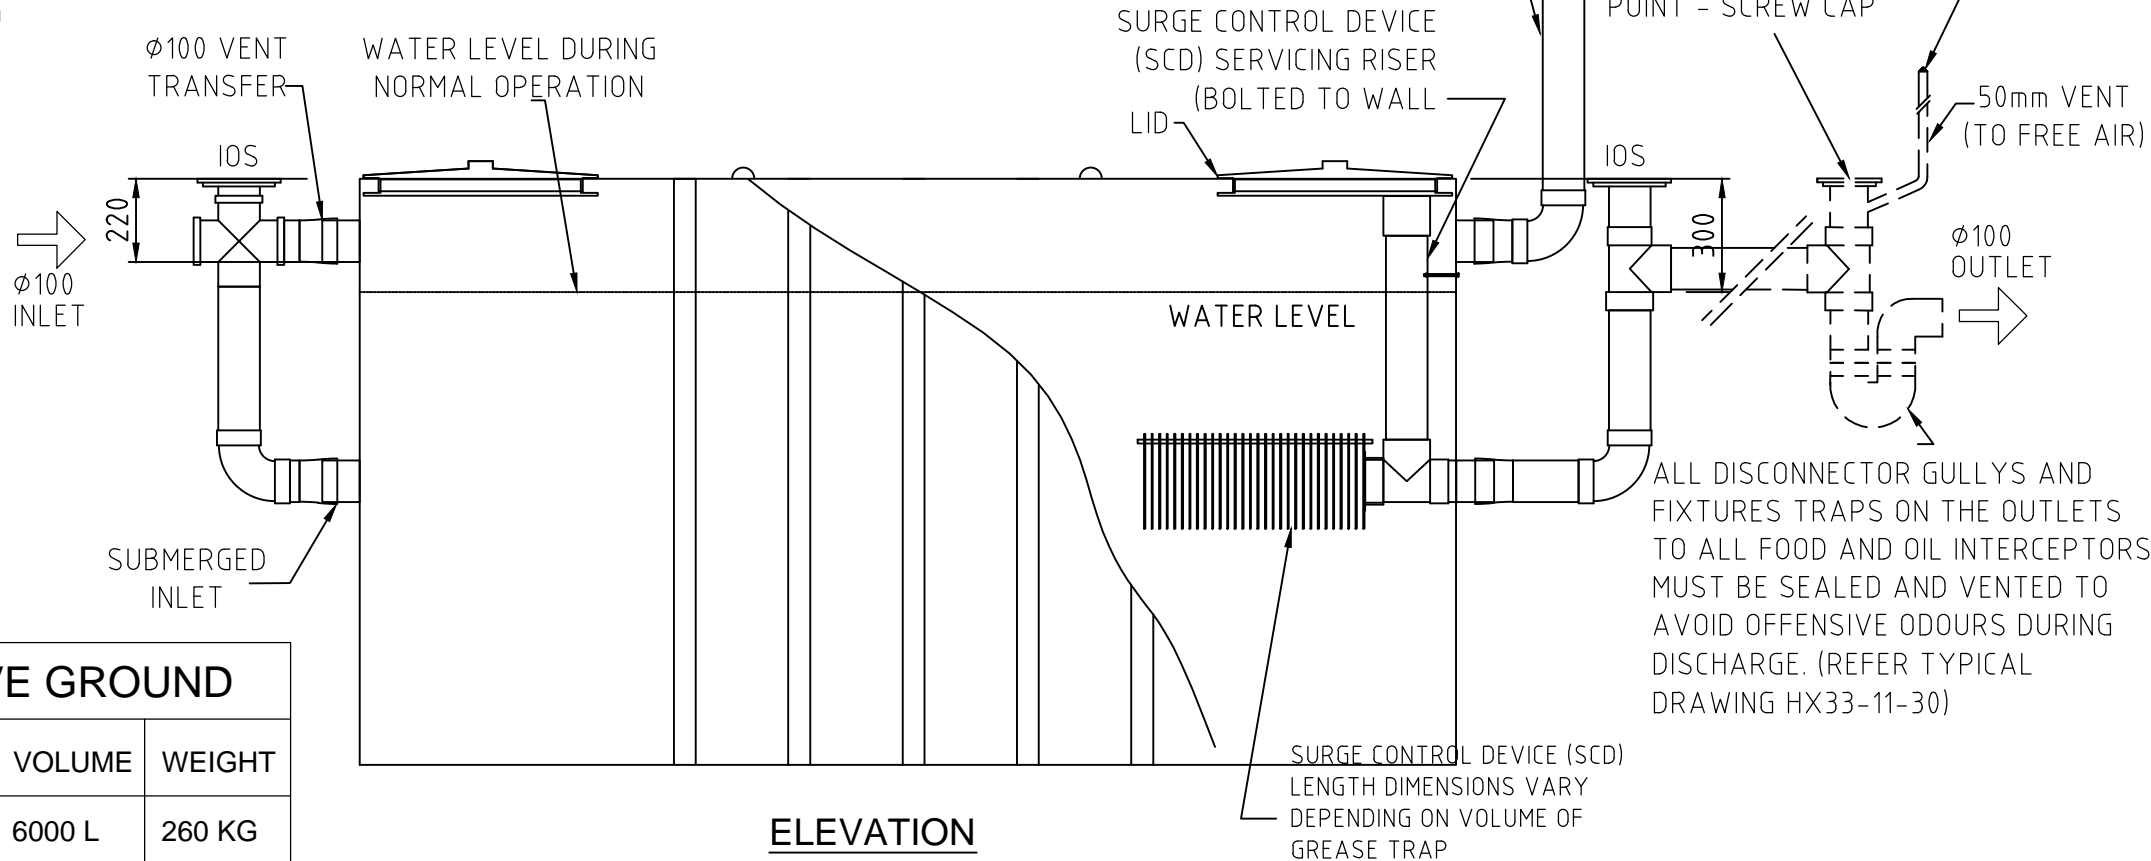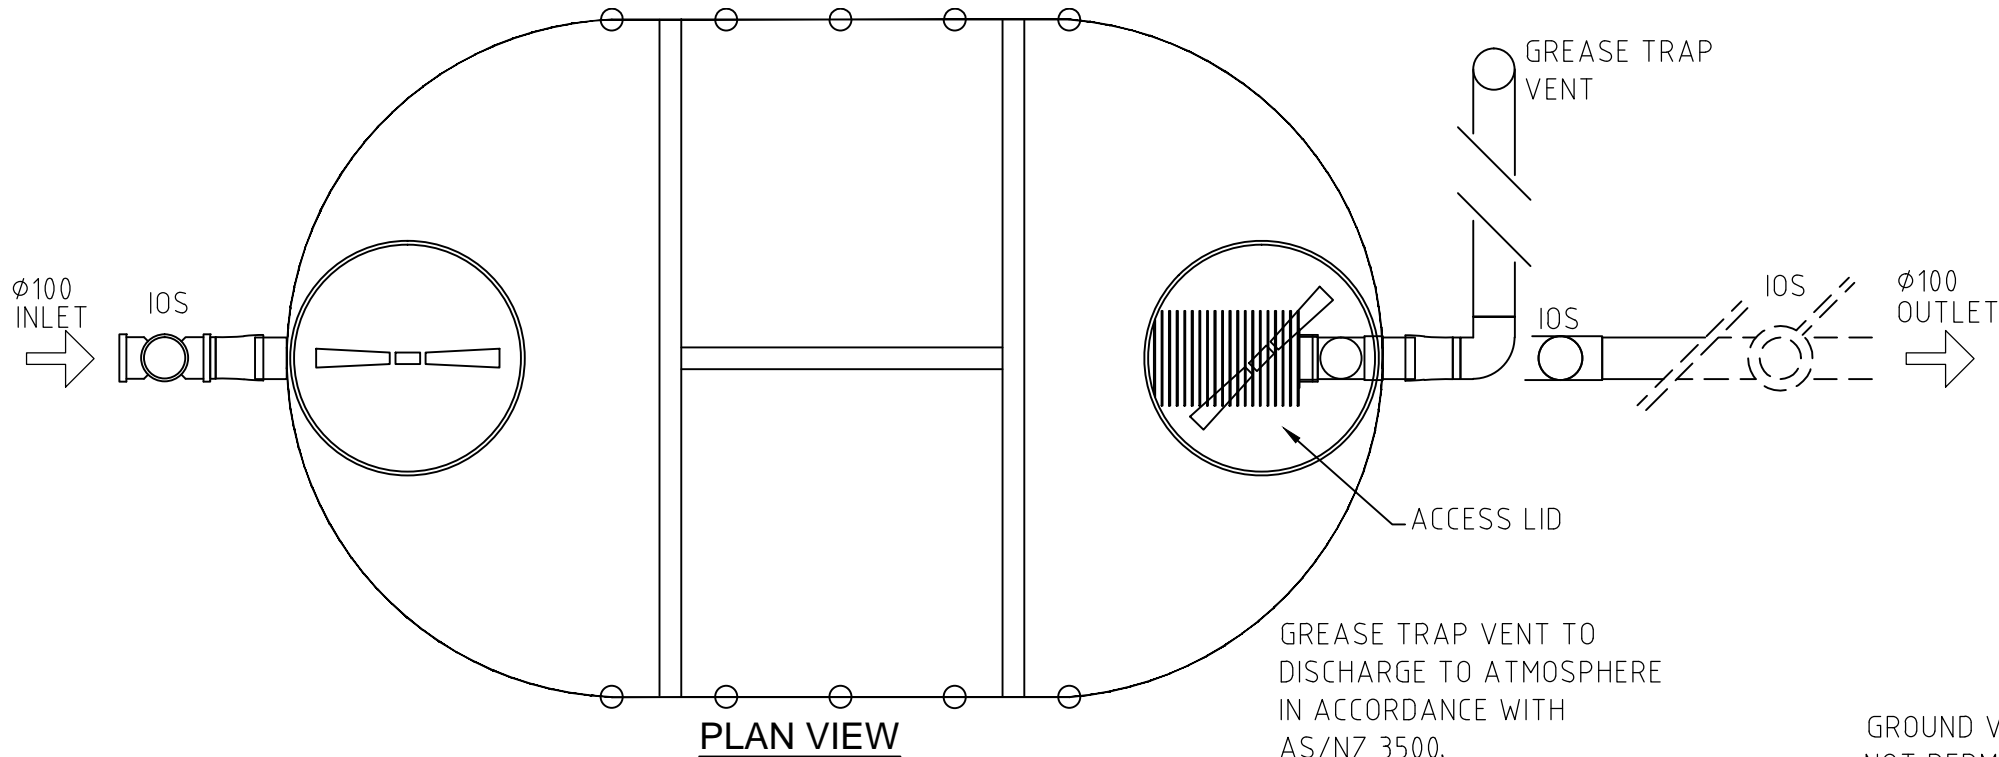

| HALGAN MGTA6000-WA ABOVE GROUND | | | | | |
|---------------------------------|--------|--------|--------|--------|--------|
| MODEL | HEIGHT | WIDTH | LENGTH | VOLUME | WEIGHT |
| MGTA6000-WA | 1550mm | 1850mm | 3100mm | 6000 L | 260 KG |

| REV | DATE | DESCRIPTION | BY | CHKD | APP |
|-----|------------|----------------------|----|------|-----|
| A-1 | 11.01.2017 | UPDATE DETAIL DESIGN | LB | JB | KH |
| A | 02-06-2014 | DETAIL DESIGN | NM | SM | KH |

THIS DRAWING AND THE INFORMATION CONTAINED HEREON ARE THE PROPERTY OF HALGAN PTY LTD AND MUST NOT BE COPIED, REPRODUCED OR USED WITHOUT THE WRITTEN PERMISSION OF HALGAN PTY LTD.

DO NOT SCALE IF IN DOUBT ASK



Freecall 1800 626 753
22, Ethel Avenue
Brookvale NSW 2100
admin@halgan.com.au
www.halgan.com.au



HALGAN MGTA6000-WA
ABOVE GROUND DETAIL

| DRAWN | DATE |
|-------------|------------|
| LB | 11.01.2017 |
| CHECKED | SCALE |
| JB | - |
| DWG NO. | REV. |
| MGTA6000-WA | A-1 |