



GREASE INTERCEPTOR



Above-Ground

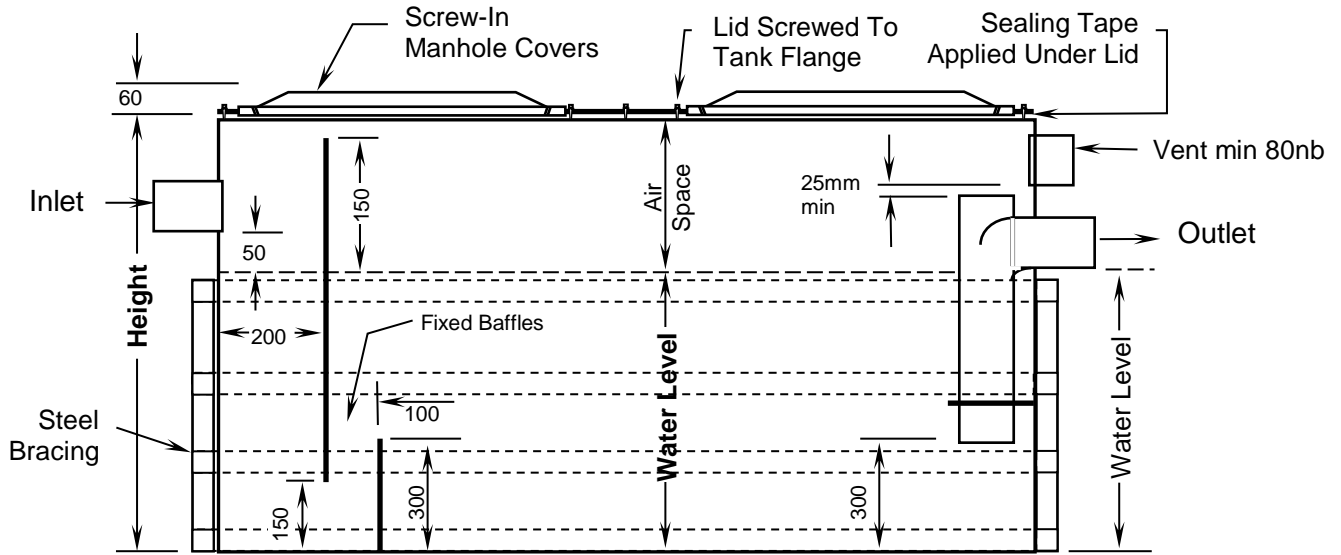

SECTION X-X

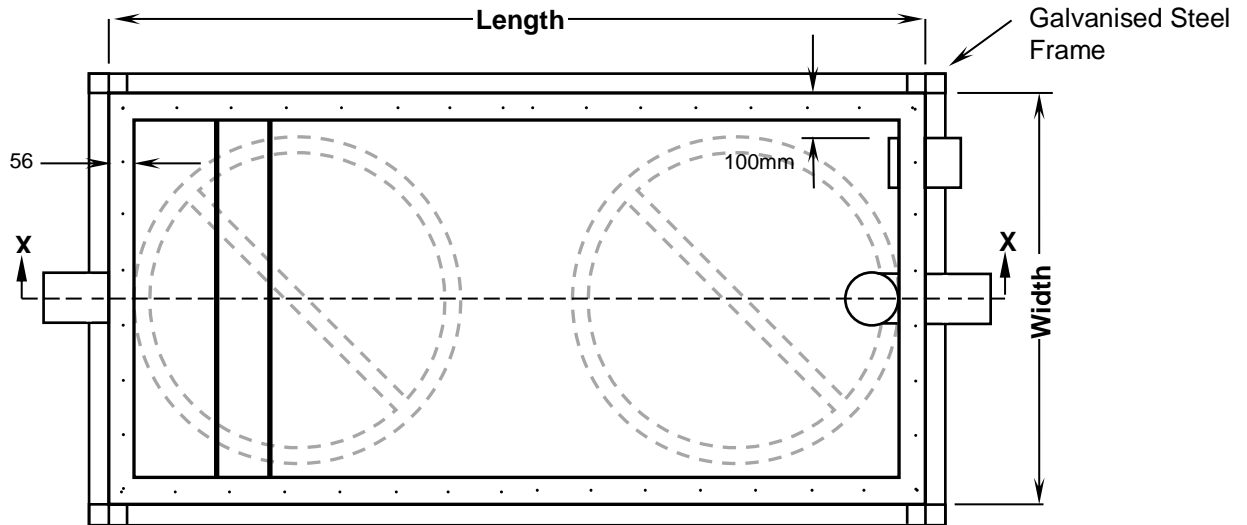

PLAN VIEW
(without lid)

NOTES:

- The interceptor, including baffle, and pipe fittings, is constructed of Polypropylene. Pipe spigots are Polypropylene.
- The interceptor is to be installed in a position that provides ready access for maintenance, inspection and cleaning purposes.
- The relevant authority must approve the proposed location of a grease interceptor prior to its installation.
- A program for regular maintenance and cleaning should be established with an authorised waste collection contractor.
- Tank is constructed to design specifications as issued by Water Corporation WA.
- **Other sizes and custom made tanks available on request.**

Dimensions (mm)

Model (Sep 2017)	Capacity (litres)	Length A	Width B	Water Level C	Height D	Inlet dia	Outlet dia	Vent dia	Air Space	Steel Frame
WP9AG540	540	1250	750	660	960	100	100	100	300	40x40
WP9AG730	730	1500	750	680	980	100	100	100	300	40x40
WP9AG1000	1000	1500	900	760	1060	100	100	100	300	40x40
WP9AG1250	1250	1500	900	950	1250	100	100	100	300	40x40
WP9AG1500	1500	2000	900	830	1130	100	100	100	300	50x50
WP9AG2000	2000	2200	900	1000	1300	100	100	100	300	50x50

For further information, contact...

Viking Plastics Engineering Pty Ltd
143 Woodlands Drive, Braeside Vic 3195

Ph 03 9587 2297

E info@vikingplastics.com.au

Fx 03 9587 1172