


GREASE INTERCEPTOR – Paneltim



Below-Ground - Medium

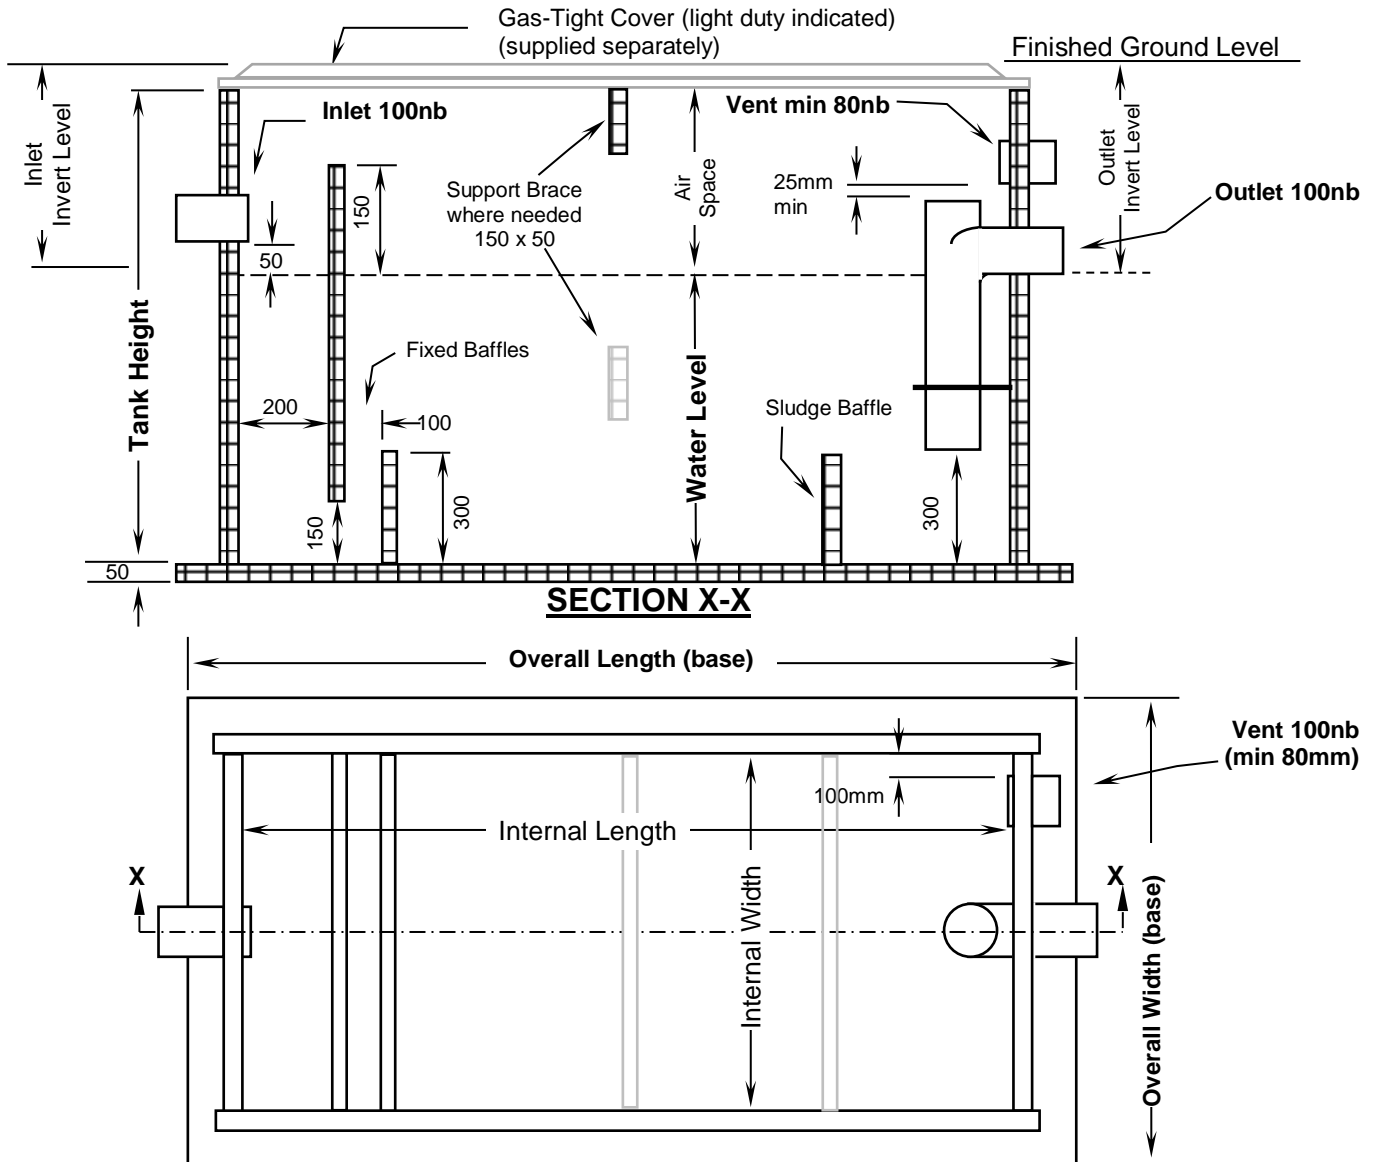

PLAN VIEW
(without cover)

NOTES:

- The entire tank, including baffles, is constructed of Paneltim construction panel. Pipe nozzles are Polyethylene or Polypropylene.
- Internal support braces are generally 150 x 50mm and the same width as the tank. They do not interfere with internal waste separation.
- Installation and burial procedures must be conducted in accordance with the Viking Paneltim Tank Installation Guidelines For Below-Ground Installations. Paneltim Tanks are designed and engineered to be installed without the need for concrete back-fill.
- Tanks must be installed according to Water Corp grease arrestor installation guidelines.
- The relevant authority must approve the proposed location of a grease interceptor prior to its installation.
- A program for regular maintenance and cleaning should be established with an authorised waste collection contractor.
- The tank design conforms to approved design drawings as issued by Water Corporation WA. We recommend the appropriateness of the tank design and its proposed location be verified for use by the local Water Authority prior to order placement.

Larger sizes and custom made tanks are available on request.

Dimensions (mm)

Model	Capacity (litres)	Internal Dimensions				Overall Dimensions (base)			Inlet Invert Level	Outlet Invert Level	Cover Height	Air Space
		Length	Width	Water	Height	Length	Width	Height				
WPT2500BG <i>(Sep 2017)</i>	2,500	2400	900	1160	1460	3000	1400	1510	310	360	60	300
WPT3000BG	3,000	2900	900	1150	1450	3400	1400	1500	310	360	60	300
WPT4000BG	4,000	2900	900	1530	1830	3400	1400	1880	310	360	60	300
WPT5000BG	5,000	4000	900	1400	1700	4500	1400	1750	310	360	60	300

For further information, contact...

Viking Plastics Engineering Pty Ltd

143 Woodlands Drive, Braeside Vic 3195

Ph 03 9587 2297

E info@vikingplastics.com.au

Fx 03 9587 1172