
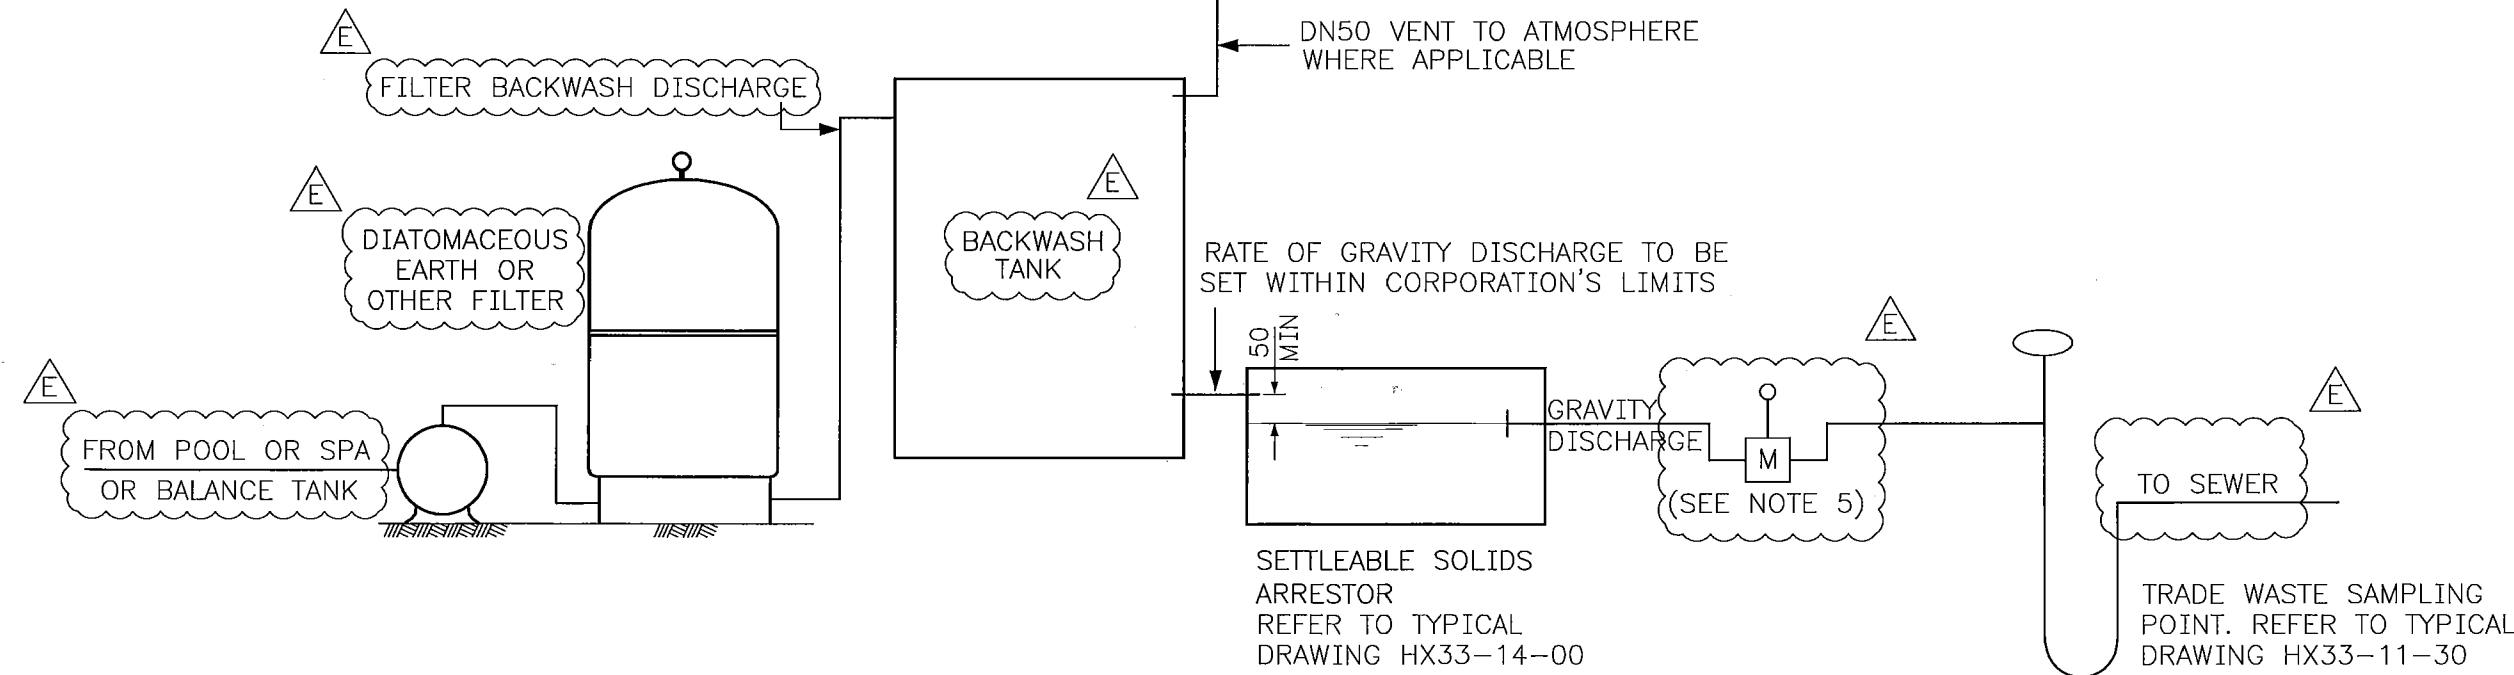


FOR MORE INFORMATION REFER TO OUR TRADE WASTE WEB PAGE  
<http://www.watercorporation.com.au/tradewaste>

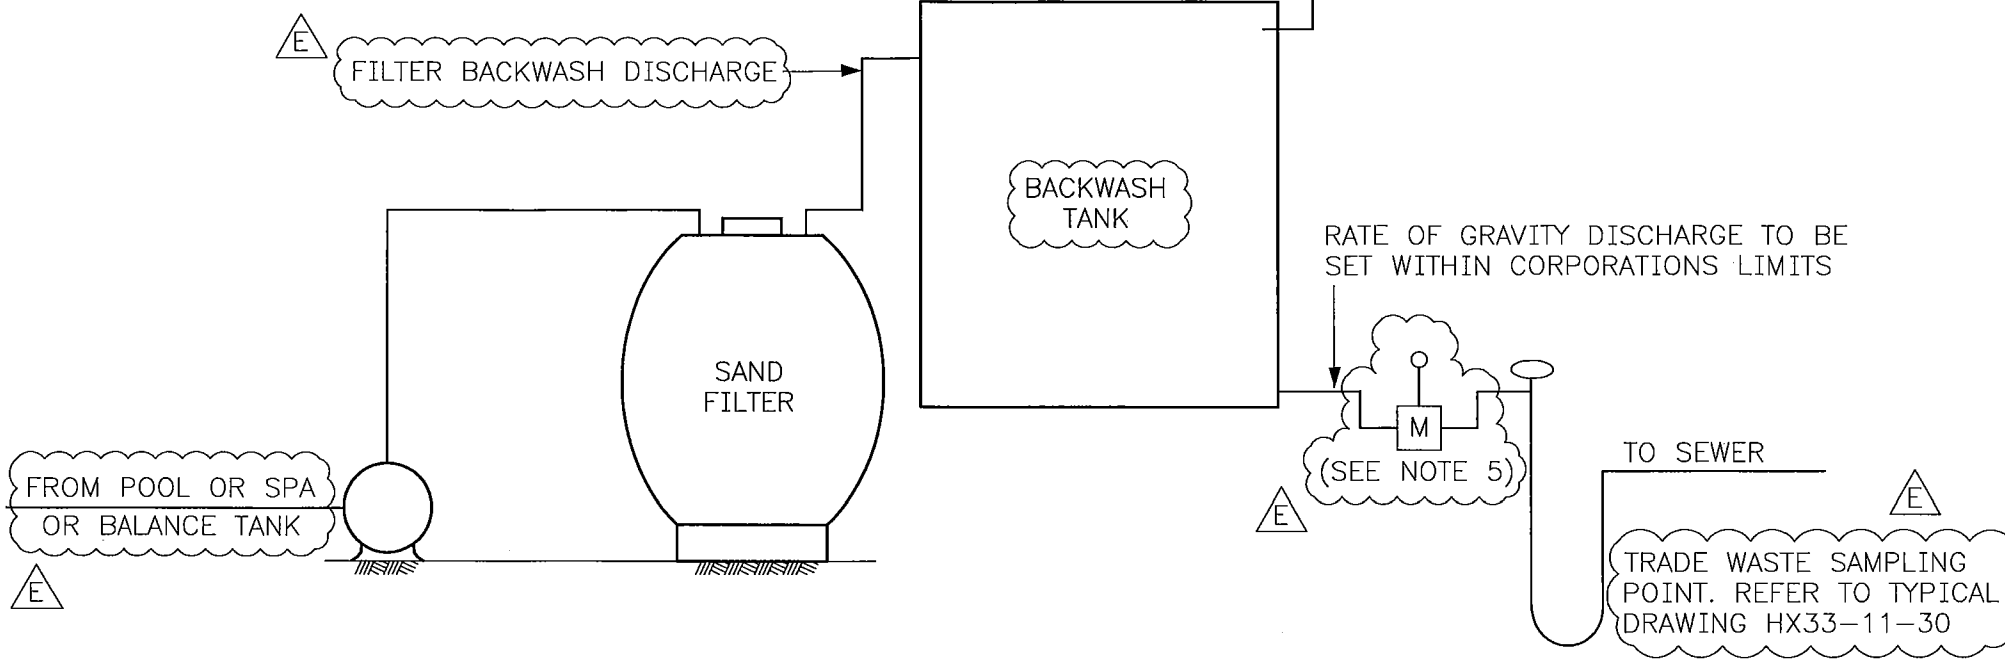

- GUIDELINES**
1. AN APPLICATION TO DISCHARGE TRADE WASTE IS REQUIRED FOR ALL AQUATIC FACILITIES.
  2. THE DISCHARGE RATE TO SEWER NOT TO EXCEED THE CORPORATION'S CURRENT LIMITS.
  3. THIS DRAWING TO BE USED IN CONJUNCTION WITH PUB20 - SWIMMING POOLS AND SPAS.
  4. TRADE WASTE SAMPLE POINT TO BE MINIMUM DN100 AND IN ACCORDANCE WITH TYPICAL DRAWING HX33-11-30
  5. INSTALLATION OF TRADE WASTE MONITORING POINT (REFER TYPICAL DRAWING HX33-20-00) MAY BE REQUIRED. CONTACT TRADE WASTE SECTION FOR ADVICE.
  6. ALL MEASUREMENTS SHOWN ARE IN MILLIMETERS.
  7. AIR ADMITTANCE VALVE SHALL NOT BE USED IN CONNECTION WITH TRADE WASTE PRE-TREATMENT FIXTURES.
  8. ALL ASSOCIATED PLUMBING WORK TO COMPLY WITH WATER SERVICES LICENSING (PLUMBERS LICENSING AND PLUMBING STANDARDS) REGULATIONS 2000 AND LATEST VERSIONS OF AS/NZS 3500.2.

ISSUE	DATE	GRID	REVISION	DRN	REC	APPD
E	06/2019		REVISED AS CLOUDED PLUS DRAWING TITLE AMENDED TO AQUATIC FACILITIES, SIGNATURES & TITLES AMENDED	BJ	ET	MS
D	07/2016		WEBSITE DETAILS ADDED, GUIDELINES AMENDED	BJ	SJ	MS
C	06/2009		NOTES 10 & 11 ADDED	RJ	GC	AM
B	12/2005		SETTLEABLE SOLIDS ARRESTOR AMENDED	KLM	AM	VM

SCALE: DIAGRAMMATIC

DES CALC	RECOMMENDED	12/06/2019		WATER CORPORATION TYPICAL DRAWINGS FOR TRADE WASTE CONNECTION TO SEWER OF AQUATIC FACILITIES FORMERLY TYPICAL DRAWING 1830	ORIGINAL SHEET SIZE
DES CHD	E. TRISTANTO				A3
DRN	APPROVED	12/06/2019	WATER CORPORATION TYPICAL DRAWINGS FOR TRADE WASTE CONNECTION TO SEWER OF AQUATIC FACILITIES FORMERLY TYPICAL DRAWING 1830	FILE	PLAN HX33-18-30
A CLEAVER	M. STARK			PROJECT	
Q.C. CHD	MANAGER, COMMERCIAL & INDUSTRIAL SERVICES				E
G CLEAVER					MF 08 JUL 2019