


FOR MORE INFORMATION REFER TO OUR TRADE WASTE WEB PAGE
<http://www.watercorporation.com.au/tradewaste>

GUIDELINES

1. PVC IS NOT RECOMMENDED FOR USE IN THE WASTE LINE TO THE TRADE WASTE SAMPLING POINT. REFER TO TYPICAL DRAWING HX33-11-30.
2. ALL MEASUREMENTS SHOWN ARE IN MILLIMETRES.
3. AIR ADMITTANCE VALVE SHALL NOT BE USED IN CONNECTION WITH TRADE WASTE.
4. ALL ASSOCIATED PLUMBING WORK IS TO COMPLY WITH THE PLUMBERS LICENSING AND PLUMBING STANDARDS REGULATIONS 2000 (THE PLUMBING REGULATIONS) AND LATEST VERSIONS OF AS/NZS 3500.1 AND AS/NZS 3500.2.
5. IF SAMPLE POINT IS LOCATED IN A DRIVEWAY AREA OR SUBJECT TO STORMWATER INTRUSION, THEN IT MUST BE SEALED AND VENTED IN ACCORDANCE WITH TYPICAL DRAWING HX33-10-10.

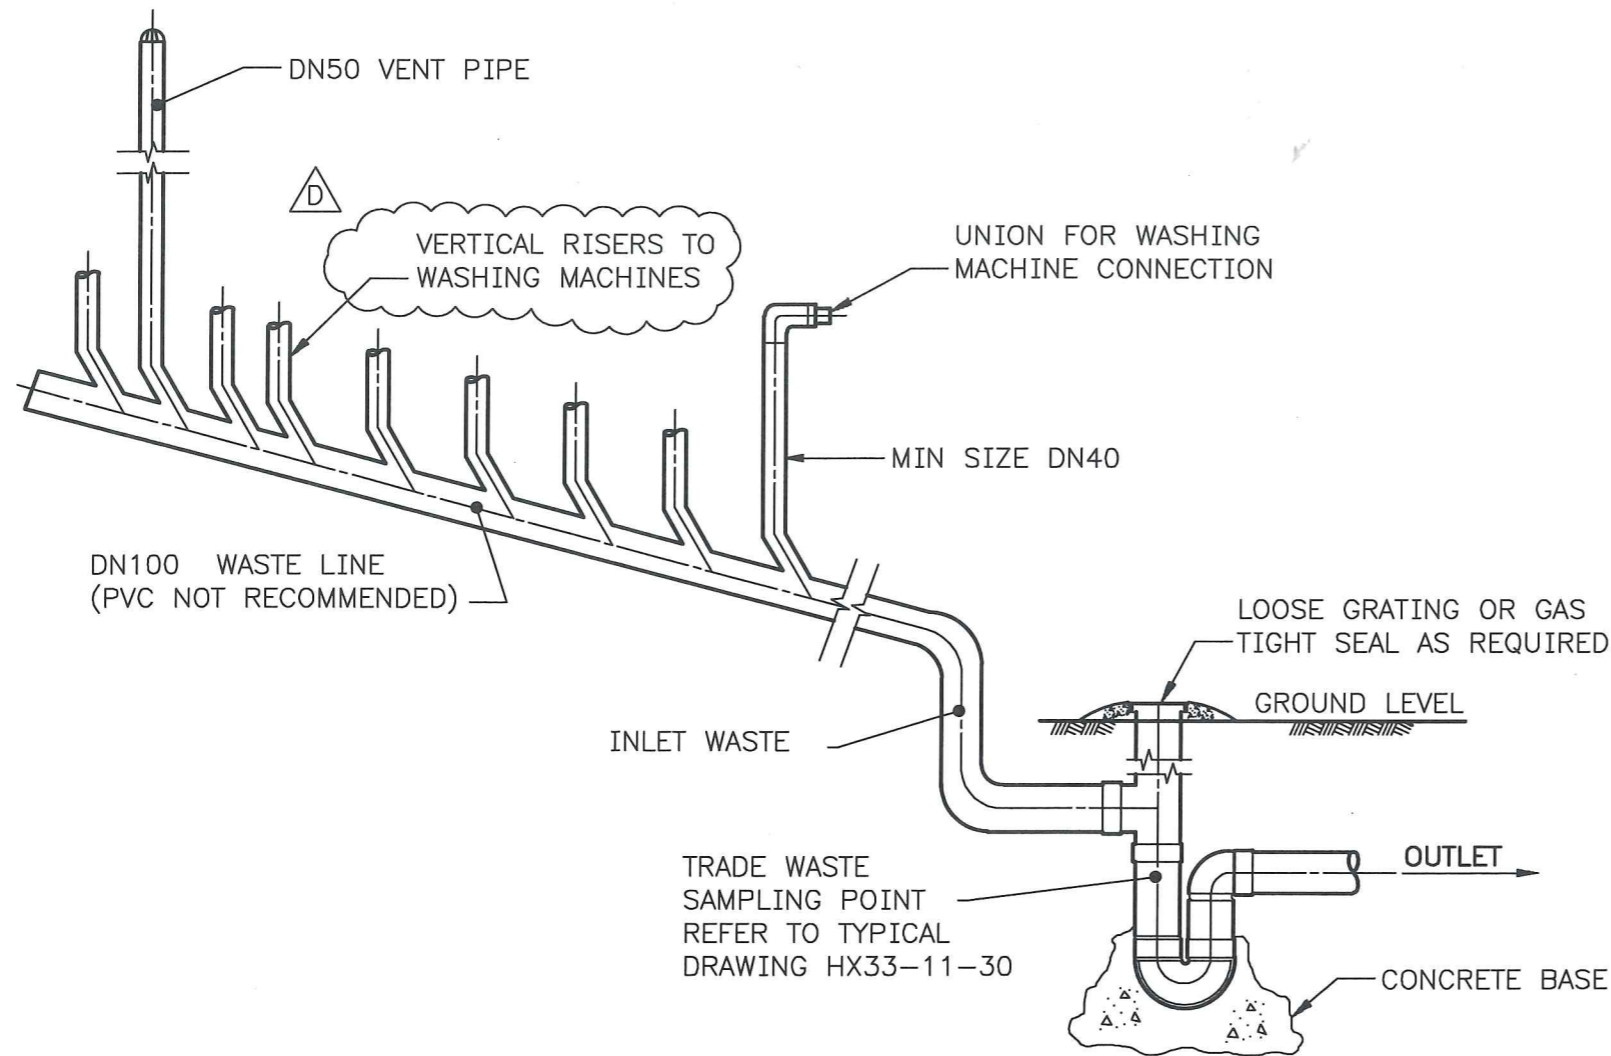

ELEVATION

D	02/2020		PLUMBING REGULATION TITLE UPDATED, NOTE 5 ADDED, MINOR UPDATES	JMS	<i>JMS</i>	<i>MS</i>
C	07/2016		WEBSITE DETAILS ADDED, GUIDLINES AMENDED	BJ	SJ	MS
B	06/2009		NOTES 3 & 4 ADDED.	RJ	GC	AM
ISSUE	DATE	GRID	REVISION	DRN	REC	APPD

SCALE: DIAGRAMMATIC

DES CALC		RECOMMENDED	01/08/2005		WATER CORPOARTION		ORIGINAL SHEET SIZE	
DES CHD		A MANZINGER			TYPICAL DRAWINGS FOR TRADE WASTE			A3
DRN		SENIOR ASSESSMENTS OFFICER			LAUNDROMAT INSTALLATION			
A CLEAVER		APPROVED	01/08/2005	FILE	58584703	PLAN	CAD ISSUE	
Q.C. CHD		J HEWITT		PROJECT		HX33-18-00	D MF	
G CLEAVER		MANAGER, INDUSTRIAL WASTES						