


FOR MORE INFORMATION REFER TO OUR WEBSITE  
[watercorporation.com.au/tradewaste](http://watercorporation.com.au/tradewaste)

**GUIDELINES**

- MARINE SULLAGE UNITS ON UNMANNED SITES ARE TO BE FITTED WITH A CONTROLLED ACCESS ie. TOKENS, COINS OR CARD SYSTEMS.
- MARINE SULLAGE UNITS SHALL DISCHARGE TO SEWER VIA A TRADE WASTE MONITORING POINT.
- FLOW METERS TO BE INSTALLED IN ACCORDANCE WITH TYPICAL DRAWING HX33-20-00 TRADE WASTE MONITORING POINT.
- TRADE WASTE SAMPLING POINT SHALL BE SEALED WITH A REMOVABLE LID AND BE VENTED TO ATMOSPHERE.
- AIR ADMITTANCE VALVE SHALL NOT BE USED IN CONNECTION WITH TRADE WASTE PRE-TREATMENT FIXTURES. THIS DRAWING IS TO BE USED IN CONJUNCTION WITH PUB26 - DISCHARGE OF PORTABLE TOILET WASTE.
- ALL ASSOCIATED PLUMBING WORK IS TO COMPLY WITH THE PLUMBERS LICENSING AND PLUMBING STANDARDS REGULATIONS 2000 (THE PLUMBING REGULATIONS) (AS AMENDED)

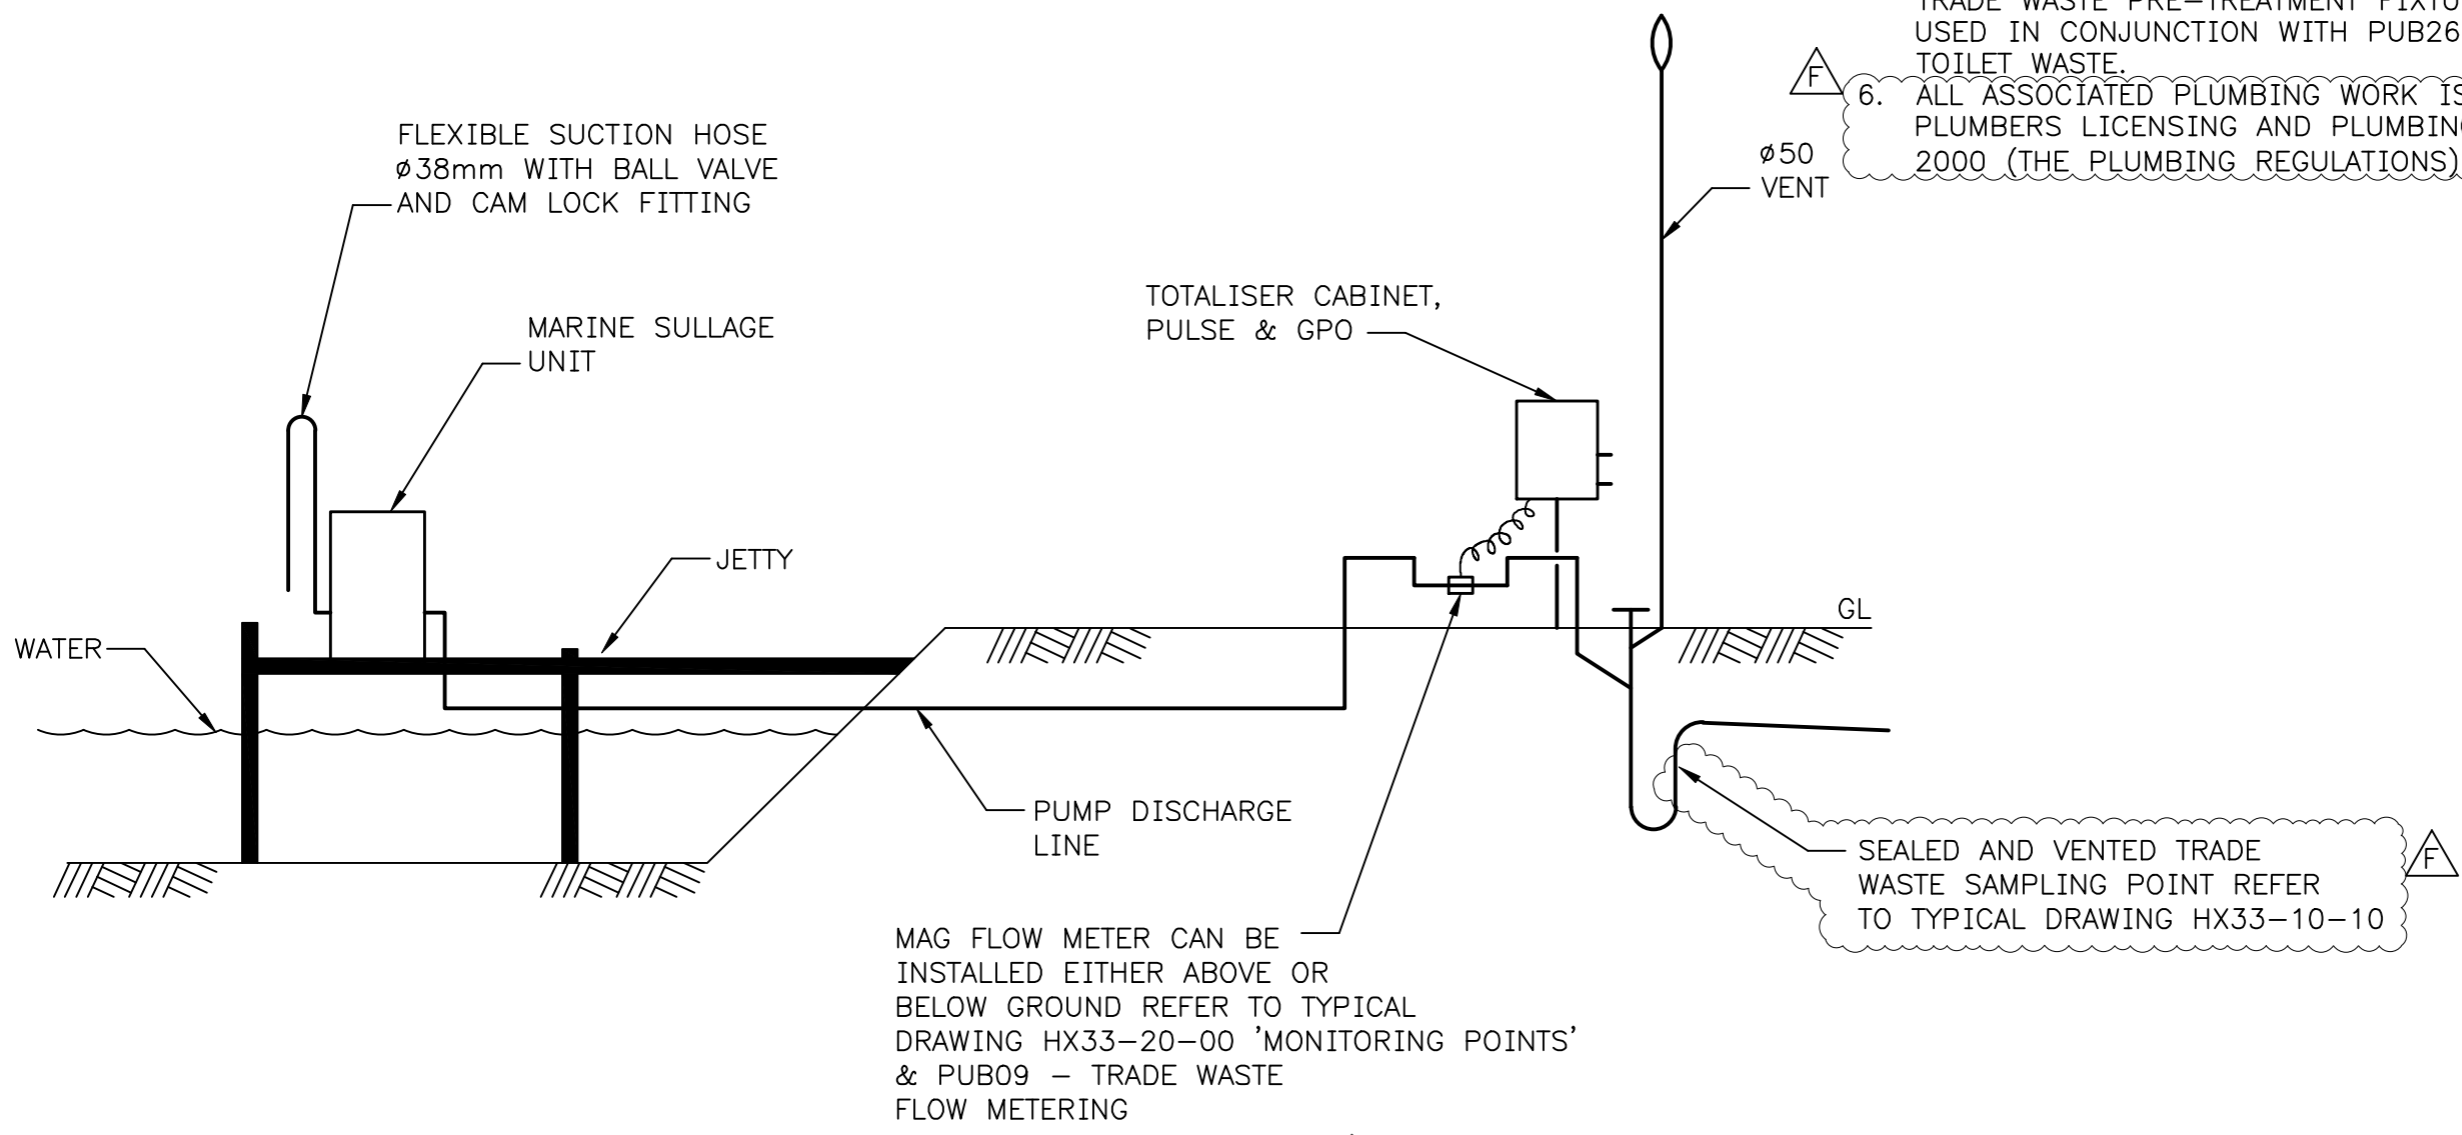

ISSUE	DATE	GRID	REVISION	DRN	REC	APPD
F	05/2024		TRADE WASTE SAMPLING POINT REF AMENDED	JD	NT	MS
E	02/2020		PLUMBING REGULATION TITLE UPDATED, FORMELY TYPICAL DRAWING REFERENCE REMOVED.	JMS	NT	MS
D	07/2016		WEBSITE DETAILS ADDED, GUIDELINES AMENDED	BJ	SJ	MS
C	01/2012		NOTE AND GUIDELINES MODIFIED	BJ	MS	AM
B	06/2009		NOTE 5 REMOVED, NOTES 5,6 & 7 ADDED	RY	GC	AM

SCALE: DIAGRAMMATIC

DES CALC	RECOMMENDED	01/08/2005		WATER CORPORATION		ORIGINAL SHEET SIZE
DES CHD	A MANZINGER	SENIOR ASSESSMENTS OFFICER		TYPICAL DRAWINGS FOR TRADE WASTE		
DRN	APPROVED	01/08/2005		MARINE SULLAGE UNITS		A3
K MCGREGOR	J HEWITT	MANAGER, INDUSTRIAL WASTES		FILE	58584710	
Q.C. CHD				PROJECT	HX33-18-70	F MF
G CLEAVER						