


FOR MORE INFORMATION REFER TO OUR TRADE WASTE WEB PAGE
<http://www.watercorporation.com.au/tradewaste>

GUIDELINES



1. MARINE SULLAGE UNITS ON UNMANNED SITES ARE TO BE FITTED WITH A CONTROLLED ACCESS ie. TOKENS, COINS OR CARD SYSTEMS.
2. MARINE SULLAGE UNITS SHALL DISCHARGE TO SEWER VIA A TRADE WASTE MONITORING POINT.
3. FLOW METERS TO BE INSTALLED IN ACCORDANCE WITH TYPICAL DRAWING HX33-20-00 TRADE WASTE MONITORING POINT.
4. TRADE WASTE SAMPLING POINT SHALL BE SEALED WITH A REMOVABLE LID AND BE VENTED TO ATMOSPHERE.
5. AIR ADMITTANCE VALVE SHALL NOT BE USED IN CONNECTION WITH TRADE WASTE PRE-TREATMENT FIXTURES. THIS DRAWING IS TO BE USED IN CONJUNCTION WITH PUB26 - DISCHARGE OF PORTABLE TOILET WASTE.
6. ALL ASSOCIATED PLUMBING WORK IS TO COMPLY WITH THE PLUMBERS LICENSING AND PLUMBING STANDARDS REGULATIONS 2000 (THE PLUMBING REGULATIONS) AND LATEST VERSIONS OF AS/NZS 3500.1 AND AS/NZS 3500.2.

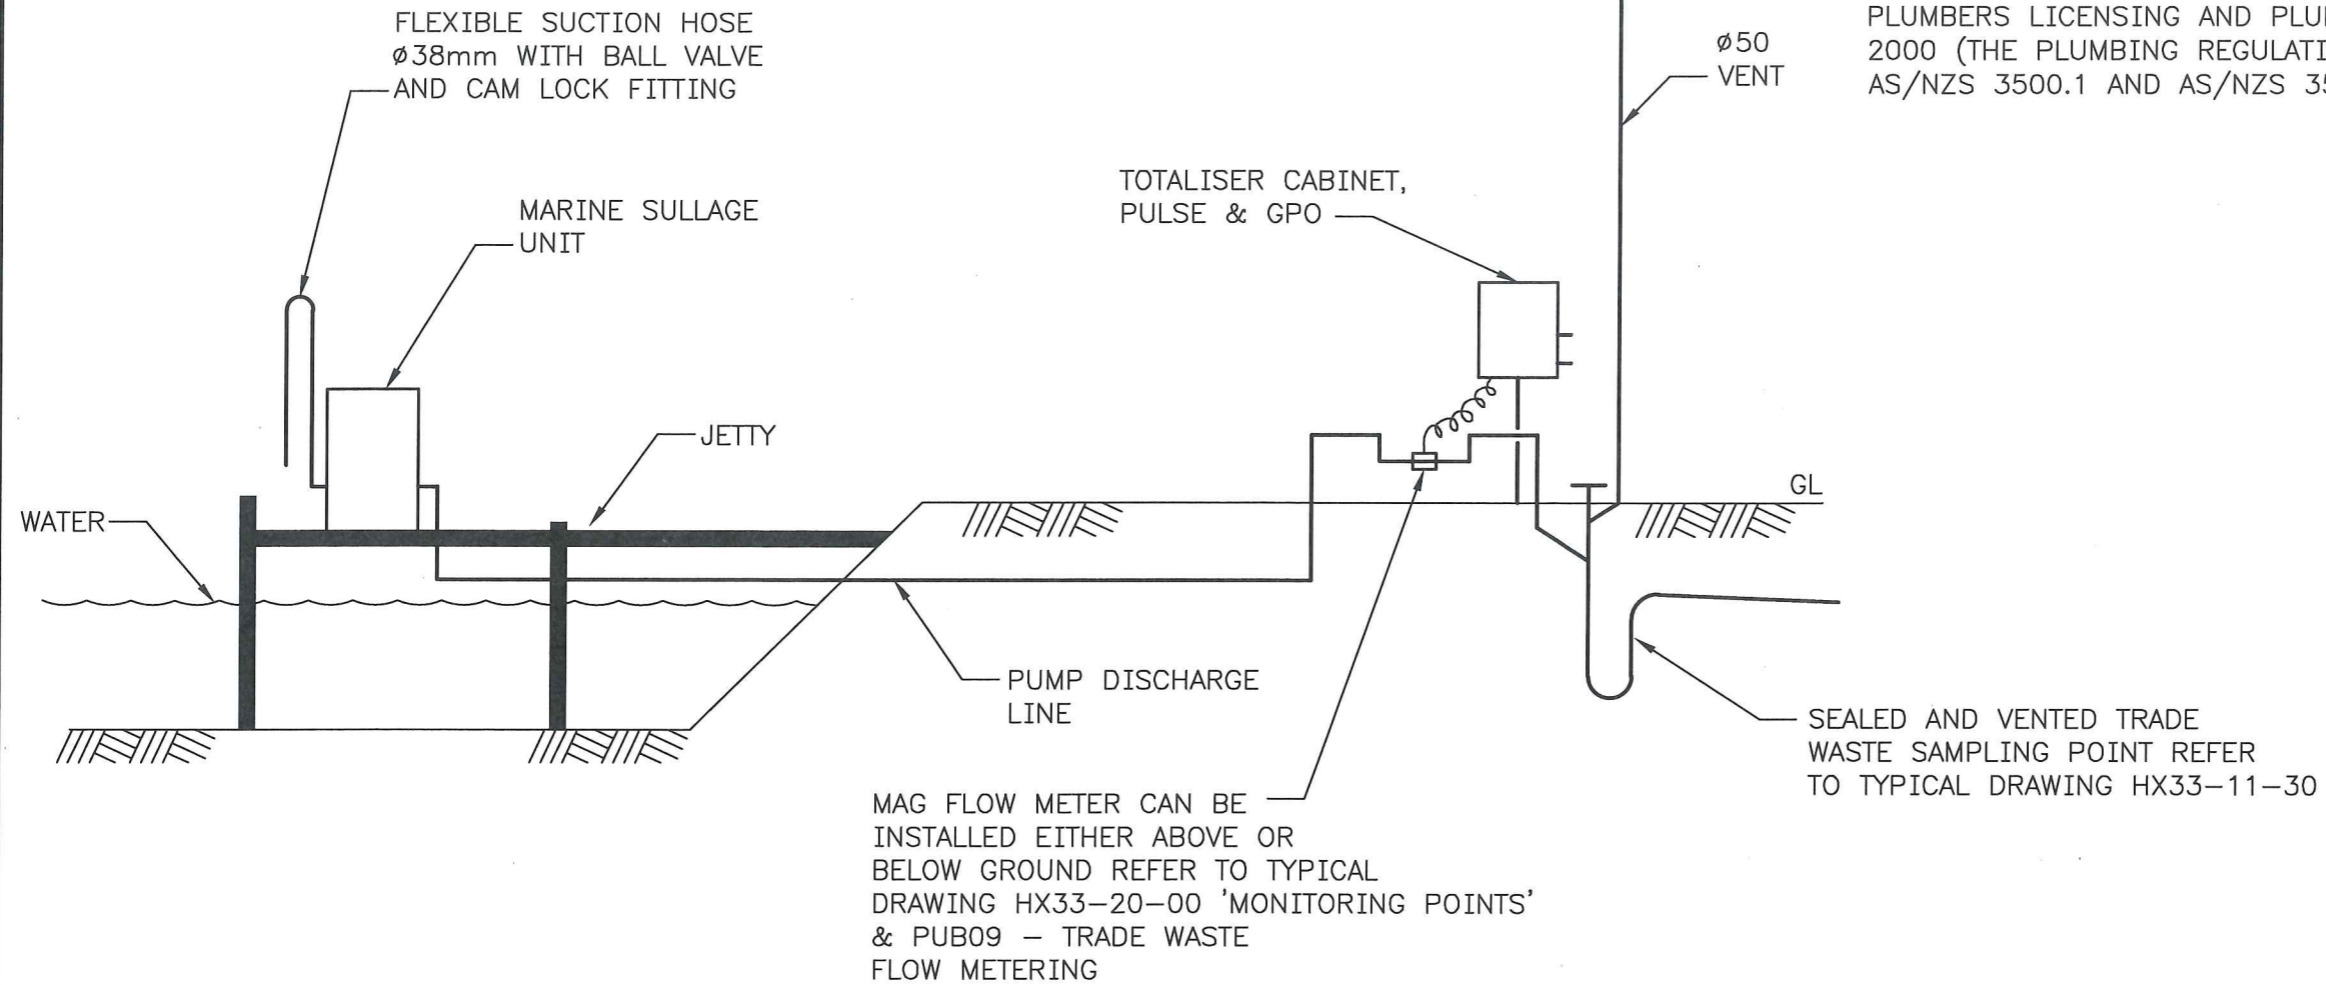

ISSUE	DATE	GRID	REVISION	DRN	REC	APPD
E	02/2020		PLUMBING REGULATION TITLE UPDATED, FORMERLY TYPICAL DRAWING REFERENCE REMOVED.	JMS	<i>[Signature]</i>	<i>[Signature]</i>
D	07/2016		WEBSITE DETAILS ADDED, GUIDELINES AMENDED	BJ	SJ	MS
C	01/2012		NOTE AND GUIDELINES MODIFIED	BJ	MS	AM
B	06/2009		NOTE 5 REMOVED, NOTES 5, 6 & 7 ADDED	RY	GC	AM

SCALE: DIAGRAMMATIC

DES CALC	RECOMMENDED	01/08/2005		WATER CORPORATION TYPICAL DRAWINGS FOR TRADE WASTE MARINE SULLAGE UNITS		ORIGINAL SHEET SIZE	
DES CHD	A MANZINGER SENIOR ASSESSMENTS OFFICER			FILE	58584-710	PLAN	A3
DRN K MCGREGOR	APPROVED			PROJECT		CAD ISSUE	
Q.C. CHD G CLEAVER	01/08/2005 J HEWITT MANAGER, INDUSTRIAL WASTES		HX33-18-70		E	MF	