


**SINGLE TANK SCHEME**

**GUIDELINES**

1. AUTOMATIC VALVES AND pH PROBES MUST BE MAINTAINED TO MANUFACTURERS' SPECIFICATION.
2. ALL TANKS REQUIRE OVERFLOWS TO SELF-CONTAINED STORAGE.
3. THE INNER SURFACES OF THE TANKS TO BE CHEMICAL RESISTANT.
4. CONTROLLED PUMP OR GRAVITY DISCHARGE IS PERMITTED.
5. THE pH OF DISCHARGE MUST BE BETWEEN 6.0 AND 10.0.
6. ALL MEASUREMENTS SHOWN ARE IN MILLIMETRES.
7. ALL ASSOCIATED PLUMBING WORK IS TO COMPLY WITH THE PLUMBERS LICENSING AND PLUMBING STANDARDS REGULATIONS 2000 (THE PLUMBING REGULATIONS) AND LATEST VERSIONS OF AS/NZS 3500.1 AND AS/NZS 3500.2.
8. IF SAMPLE POINT IS LOCATED IN A DRIVEWAY AREA OR SUBJECT TO STORMWATER INTRUSION, THEN IT MUST BE SEALED AND VENTED IN ACCORDANCE WITH TYPICAL DRAWING HX33-10-10.

**LEGEND**

TWSP TRADE WASTE SAMPLING POINT

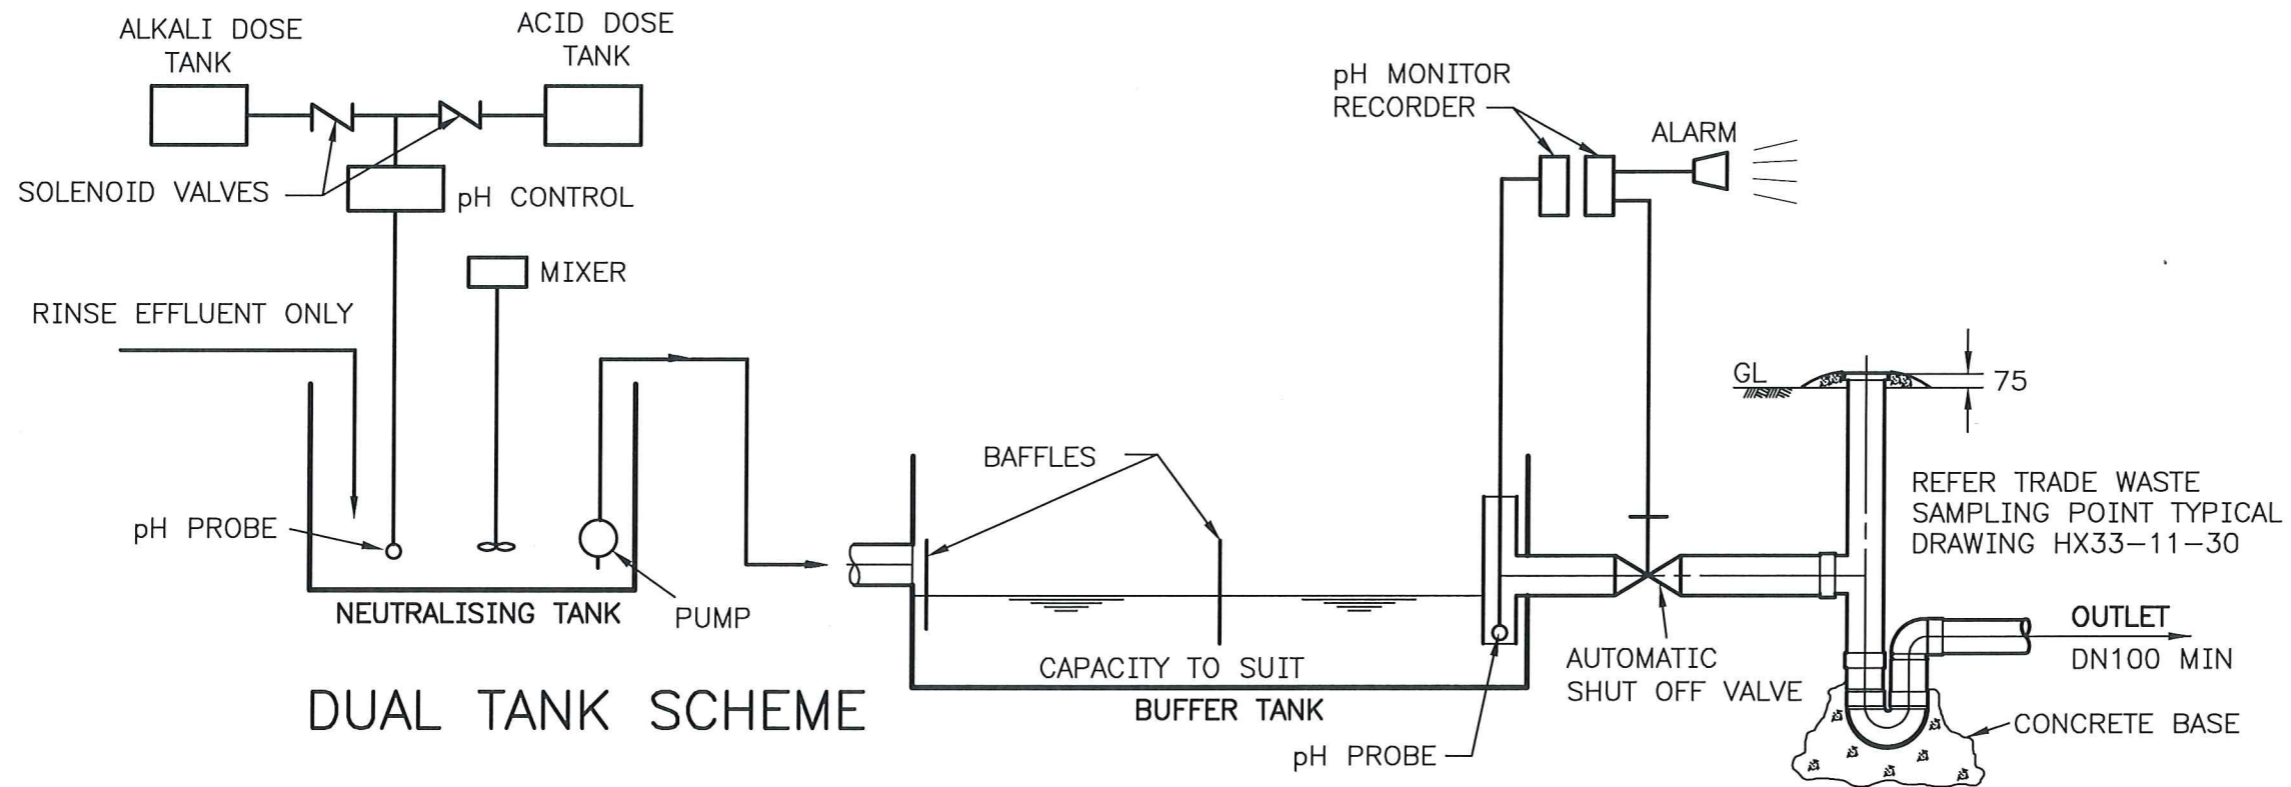

**DUAL TANK SCHEME**

ISSUE	DATE	GRID	REVISION	DRN	REC	APPD
D	02/2020		PLUMBING REGULATION TITLE UPDATED, NOTE 8 ADDED	JMS	N.T.	MS
C	07/2016		WEBSITE DETAILS ADDED, GUIDELINES AND LEGEND AMENDED	BJ	SJ	MS
B	06/2009		NOTE 8 ADDED	RJ	GC	AM

FOR MORE INFORMATION REFER TO OUR TRADE WASTE WEB PAGE  
<http://www.watercorporation.com.au/tradewaste>

SCALE: DIAGRAMMATIC

DES CALC	RECOMMENDED	01/08/2005		<b>WATER CORPORATION</b> TYPICAL DRAWINGS FOR TRADE WASTE NEUTRALISER UNIT		ORIGINAL SHEET SIZE	
DES CHD	A MANZINGER				FILE 58536723      PLAN PROJECT <b>HX33-16-10</b>		A3
DRN A CLEAVER	APPROVED	01/08/2005					J HEWITT
Q.C. CHD G CLEAVER	MANAGER, INDUSTRIAL WASTES						