


Broome Wastewater: Shire of Broome - Roebuck

NOTICE OF PROPOSAL TO CONSTRUCT TO UPGRADE WASTEWATER TREATMENT PLANT TO 7ML/d CAPACITY

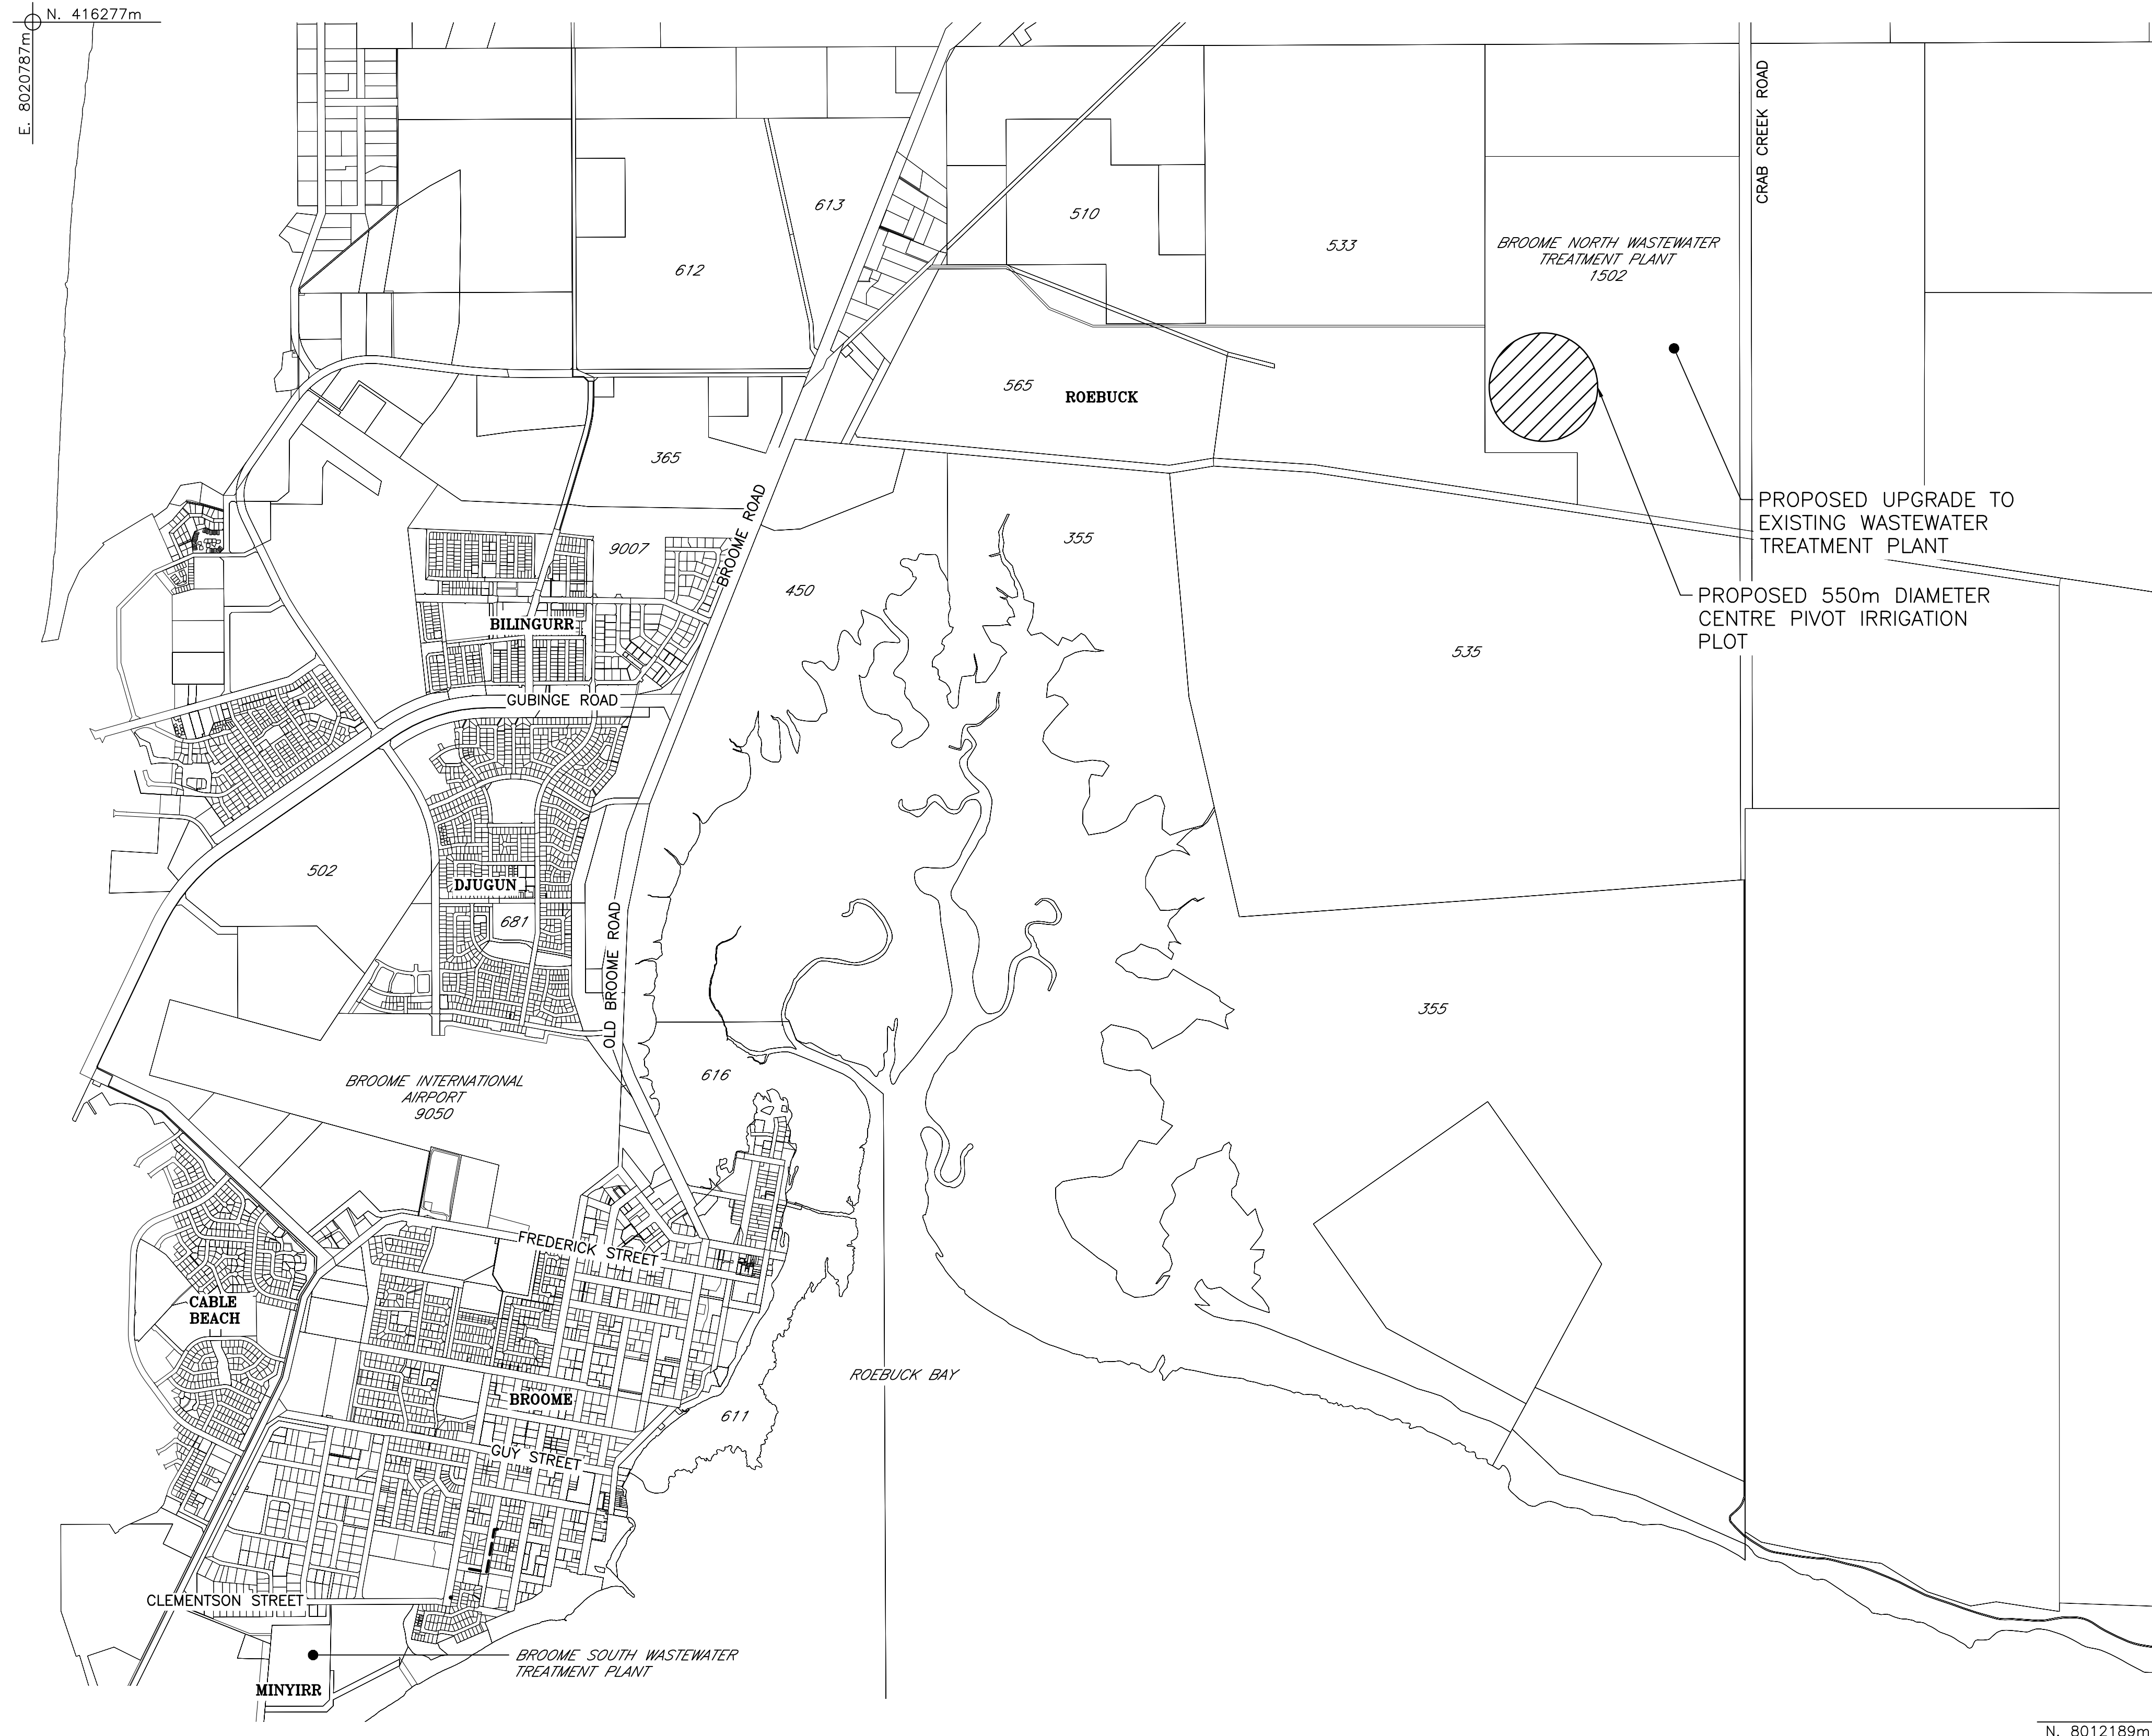

PLAN
SCALE 1:20000

To improve the efficiency of its wastewater conveyance system, the Water Corporation proposes to construct:


- Modifications and upgrades to existing inlet works and treatment ponds at the Broome North Wastewater Treatment Plant
- Modifications and upgrades to existing treated water assets at the Broome North Wastewater Treatment ponds
- A new centre pivot irrigation plot adjacent to the wastewater treatment plant

The location of the proposed works is in the Shire of Broome as shown on the plans.

The proposed works are scheduled to commence in April 2021 and will continue for a duration of approximately 20 months.

All works will be constructed to regulatory requirements. Further information may also be obtained by contacting Mr Jim Ghaswala at the Water Corporation, telephone 9420 2012.

Objections to the proposed works will be considered if lodged in writing, addressed to the Project Manager, Mr Jim Ghaswala, John Tonkin Centre, P.O. Box 100, Leederville, WA, 6902, by the deadline specified in the accompanying letter.

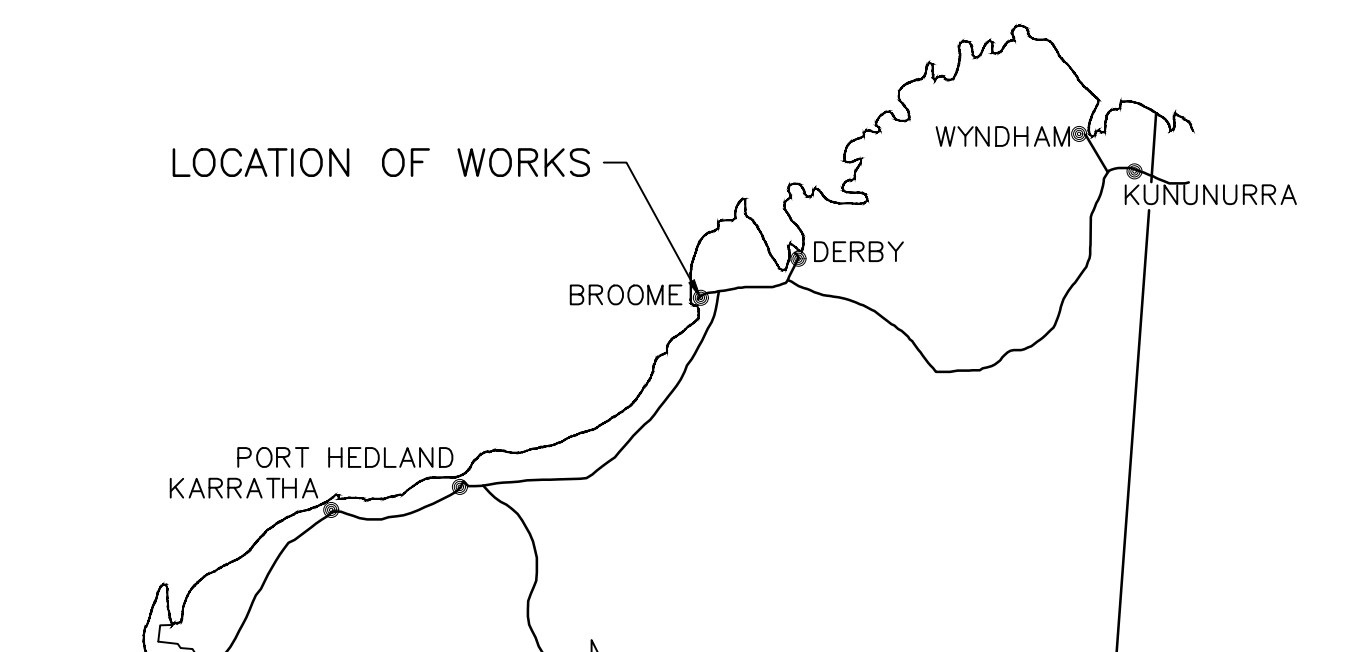

LOCALITY PLAN
SCALE: DIAGRAMMATIC

ISSUE	DATE	GRID	REVISION	DRN	REC	APPD	DESIGN SURVEY NONE	VERTICAL DATUM NONE	DES CALC S.TULLY	NORTH POINT	RECOMMENDED		BROOME WASTEWATER BROOME NORTH WASTEWATER TREATMENT PLANT PREREQUISITES TO WORK NOTICE OF PROPOSAL – MAJOR WORKS	ORIGINAL SHEET SIZE		
						ASCON SURVEY NONE	COORDINATE SYS MGA94-51	DES REF GHD 12533387	DRN S.TULLY		CONSULTANT PROJECT MANAGER			FILE	JT14-0-3	A1
								Q.C. CHD R.SPILLANE		APPROVED	PLAN			ISSUE		MF
© THIS DRAWING IS THE PROPERTY OF THE WATER CORPORATION. IT SHALL NOT BE COPIED WITHOUT PERMISSION.											CONSULTANT PROJECT DIRECTOR	PROJECT C-S03549				